


Water T&D Construction Standard

3/4" SINGLE HORN METER SETTING

Application: Residential water service

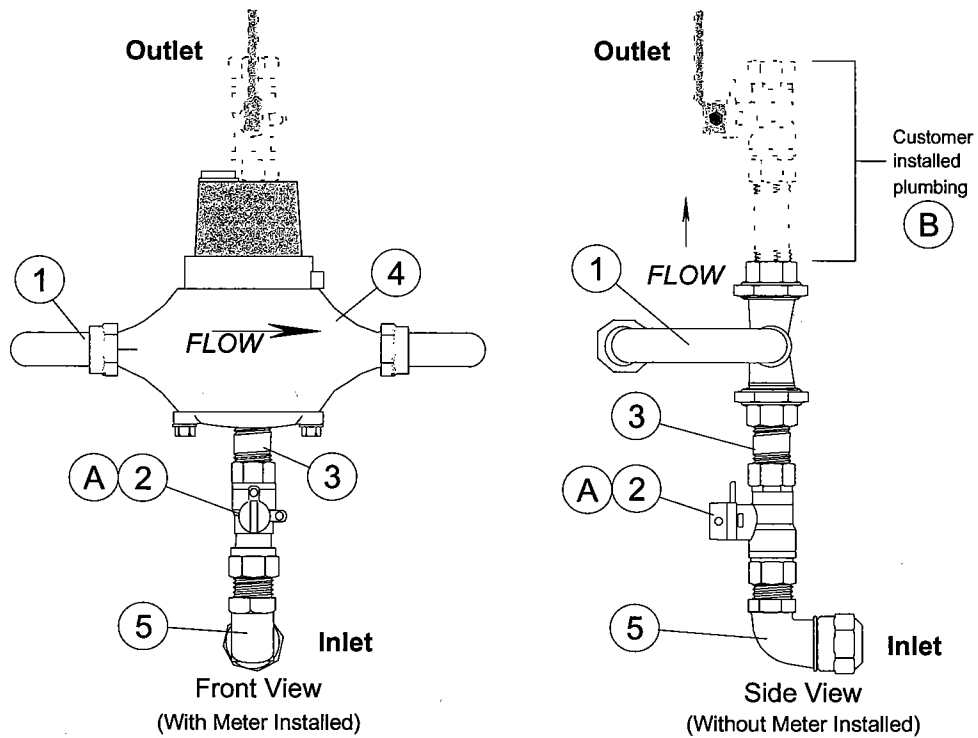


INSTALLATION NOTES

- Sending wire and touch pad shall be installed per LBWL Standard W-04-0011.

- (A) Inlet valve shall be locked in the closed position if no meter is to be installed in the meter setting.
- (B) Customer must have inlet valve installed and piping supported as required by Michigan plumbing code.

MATERIALS			
REF	ITEM NO.	QTY	DESCRIPTION
(1)	30-30828	1	Horn, 3/4" Meter, 3/4" F.I.P x 3/4" F.I.P.
(2)	30-70231	1	Valve, Ball, Straight, 3/4" F.I.P.x 1" F.I.P.
(3)	30-31263	1	Nipple, Brass, 3/4" x 2"
(4)	30-11427	*1	Meter, 3/4" Short Body
(5)	30-28287	1	Elbow, 90 Deg, 1" CTS Comp. X 1" M.I.P.
(5a)	30-25567	If Req.	Coupling, 1" CTS Comp. x 1" M.I.P.
* Installed by LBWL Meter Dept. .			



Alternate Item No. 5a
"Required if service enters through the floor"

Director of Engineering *A. Wood* Date: 8/2/06
 Director of Delivery *Michael Green* Date: 8/4/06